


# NYSSIR Process Flow Chart for Systems greater than 50 kW up to 5 MW

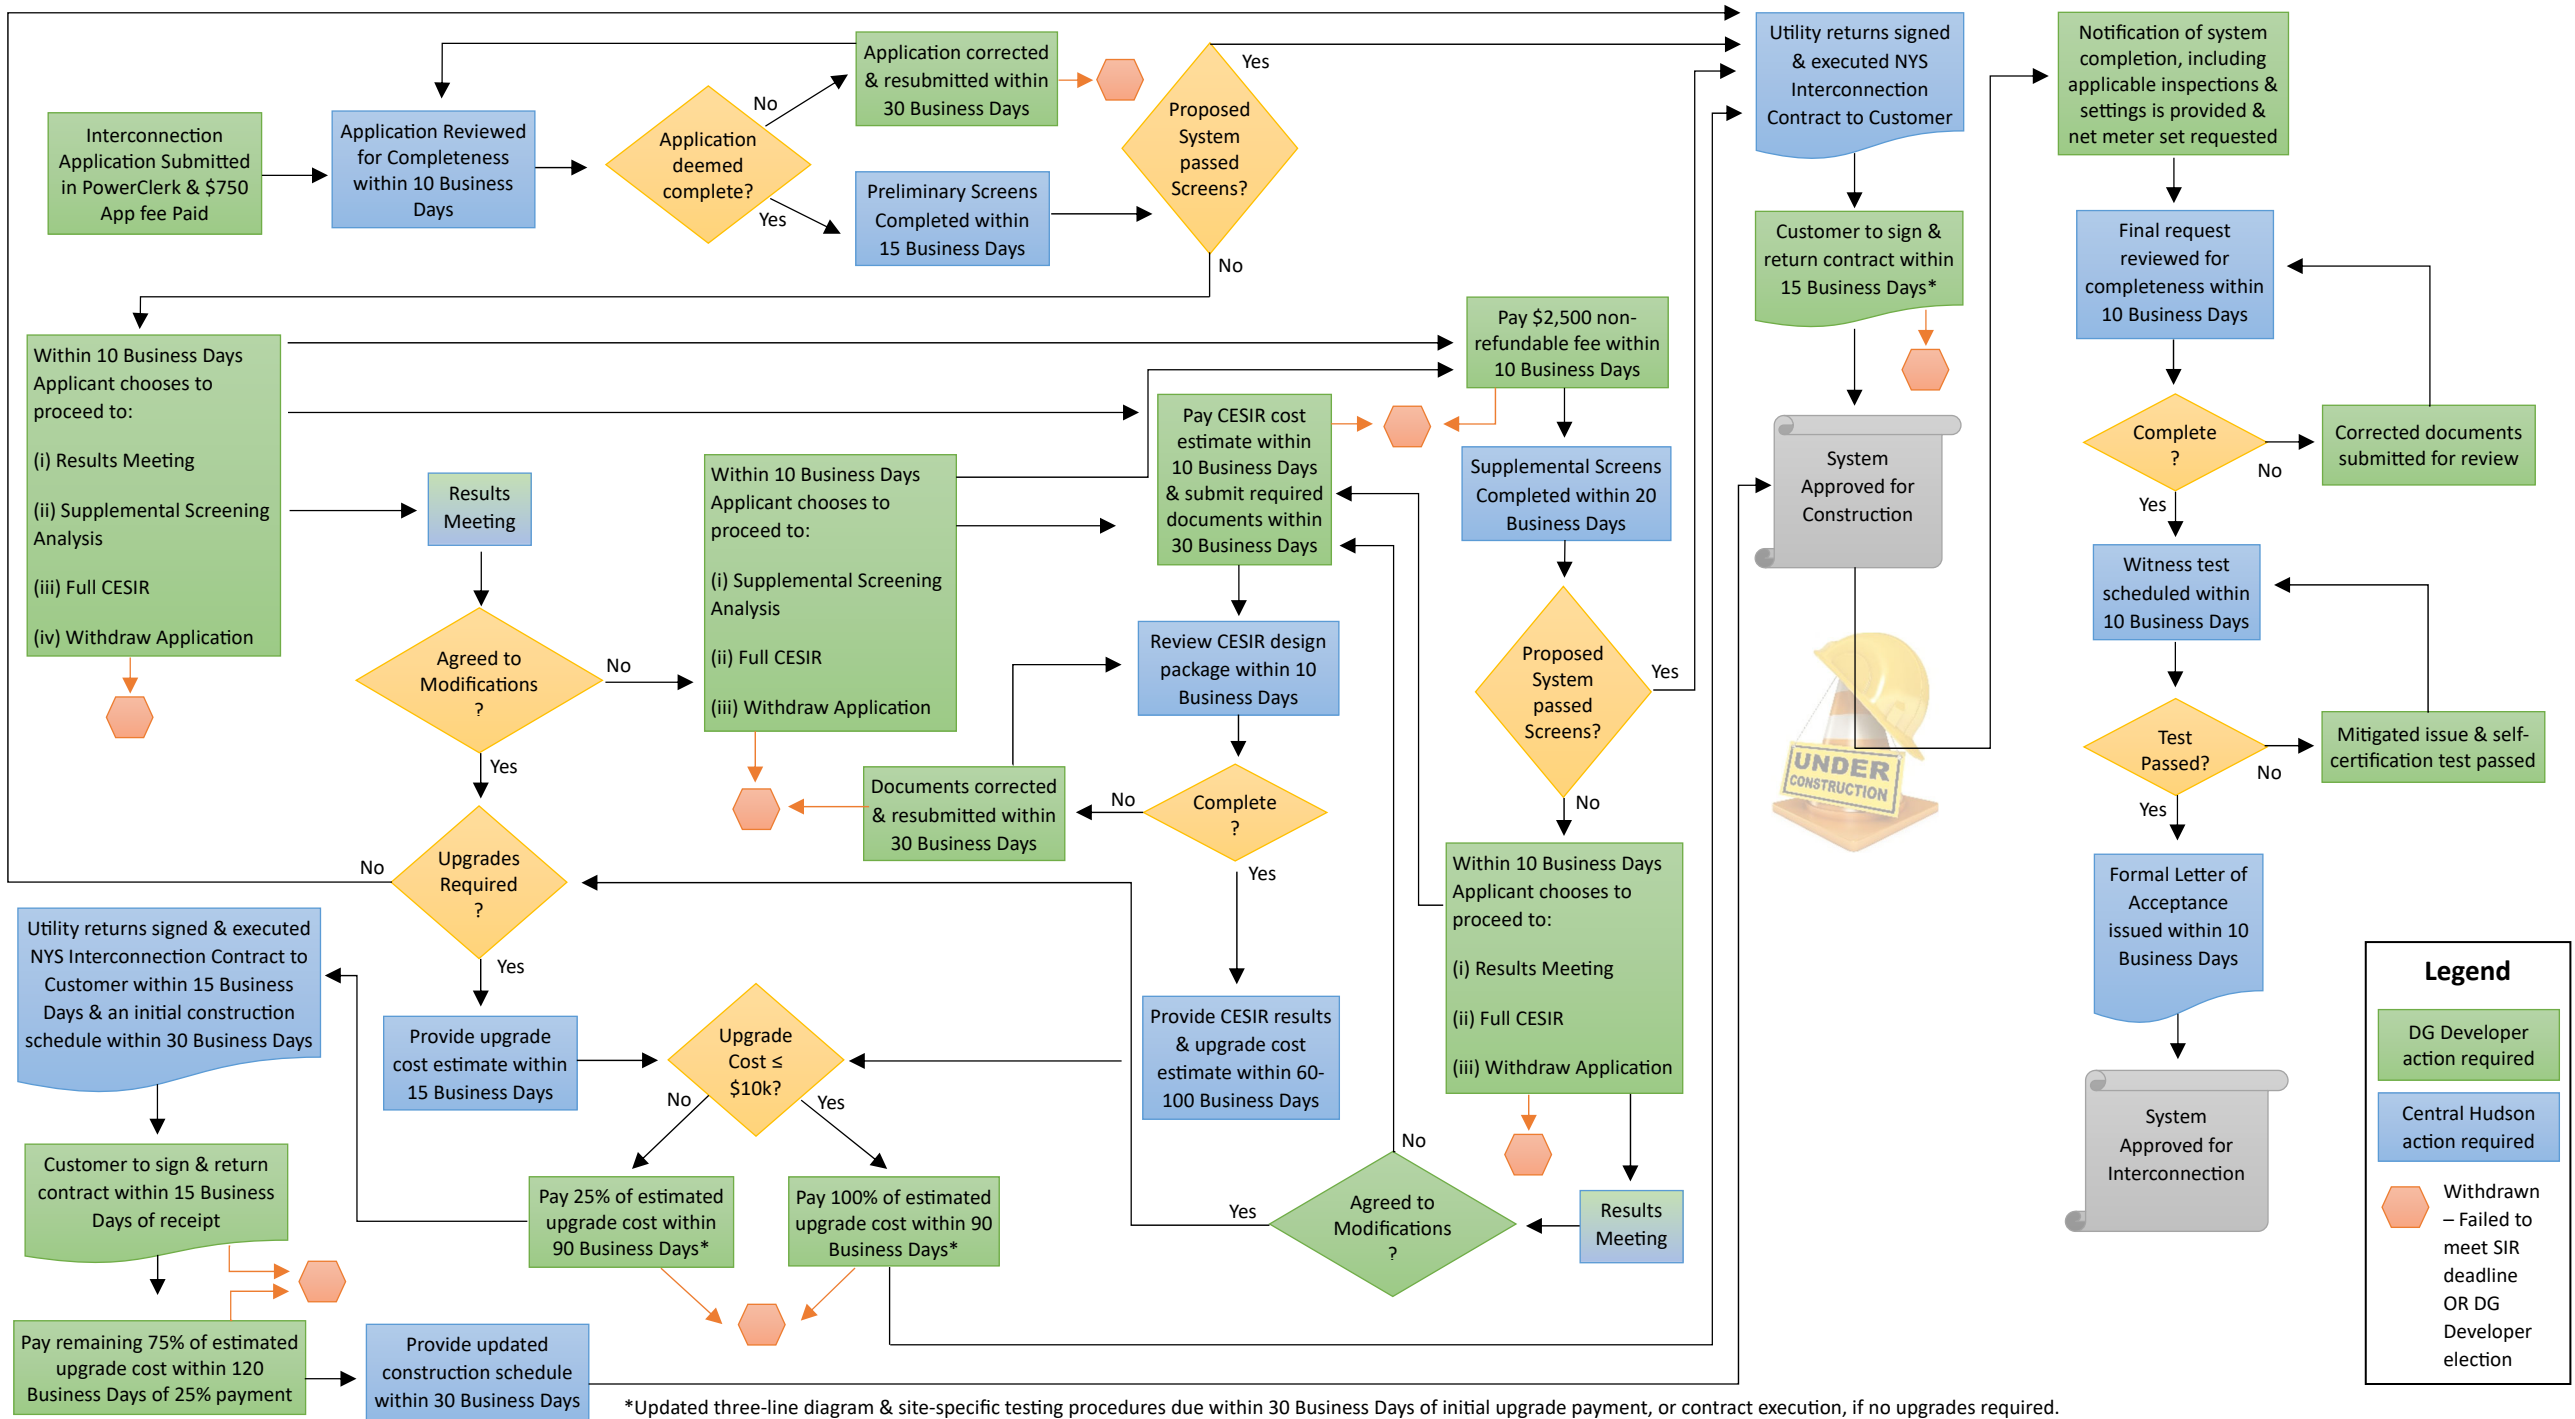

**Legend**

- DG Developer action required
- Central Hudson action required
- Withdrawn - Failed to meet SIR deadline OR DG Developer election